


HADNOT POINT

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
1	Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	\$30,000.
2	Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
15	Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
25	Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
54	Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
58	(1) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(2) Provide exterior stairs for the second floor	R-1 FY-87	12,500.
	(3) Provide one hour fire rated enclosures and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
62	(1) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(2) Provide Exterior Stairs for the second floor	R-1 FY-87	12,500.
	(3) Provide one hour fire rated enclosures and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
67	(1) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(2) Provide exterior stairs for the second floor	R-1 FY-87	12,500.
	(3) Provide one hour fire rated enclosures and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
106	Provide Automatic Sprinkler Protection and connect to Base Fire Alarm System	Scheduled for demolition FY 92	60,000.
107	Provide Automatic Sprinkler Protection and connect to Base Fire Alarm System	Scheduled for demolition FY 92	60,000.
125	(1) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(2) Provide exterior stairs for second floor	R-1 FY-87	12,500.
	(3) Provide one hour fire rated enclosure and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
206	Provide Automatic Sprinkler Protection and connect to the Base Fire Alarm System	Scheduled for demolition FY 92	60,000.
225	(1) Provide exterior stairs for the second floor	R-1 FY-87	12,500.
	(2) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(3) Provide one hour fire rated enclosures and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
226	Provide Automatic Sprinkler Protection and connect to Base Fire Alarm System	Scheduled for demolition FY-92	60,000.
307	Provide Automatic Sprinkler Protection and connect to Base Fire Alarm System	Scheduled for demolition FY-92	60,000.




HADNOT POINT Continued

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
314	Provide Automatic Sprinkler Protection and connect to Base Fire Alarm System	Scheduled for demolition FY-92	\$60,000.
322	(1) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(2) Provide exterior stairs for the second floor	R-1 FY-87	12,500.
	(3) Provide one hour fire rated enclosures and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
424	(1) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(2) Provide exterior stairs for the second floor	R-1 FY-87	12,500.
	(3) Provide one hour fire rated enclosures and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
	(4) Provide Automatic Sprinkler Protection and connect to Base Fire Alarm System	R-1 FY-87	60,000.
509	Provide Automatic Sprinkler Protection and connect to Base Fire Alarm System	R-1 FY-87	60,000.
525	(1) Provide Fire Alarm System and connect to Base Fire Alarm System	R-1 FY-87	30,000.
	(2) Provide exterior stairs for the second floor	R-1 FY-87	12,500.
	(3) Provide one hour fire rated enclosures and 3/4 hour fire doors for the interior stairs	R-2 Being Developed	6,000.
895	Remove ceiling mounted halon extinguishing cylinders and provide sprinkler protection in the Exchange computer room in building 895	R-1 FY-87	Not provided

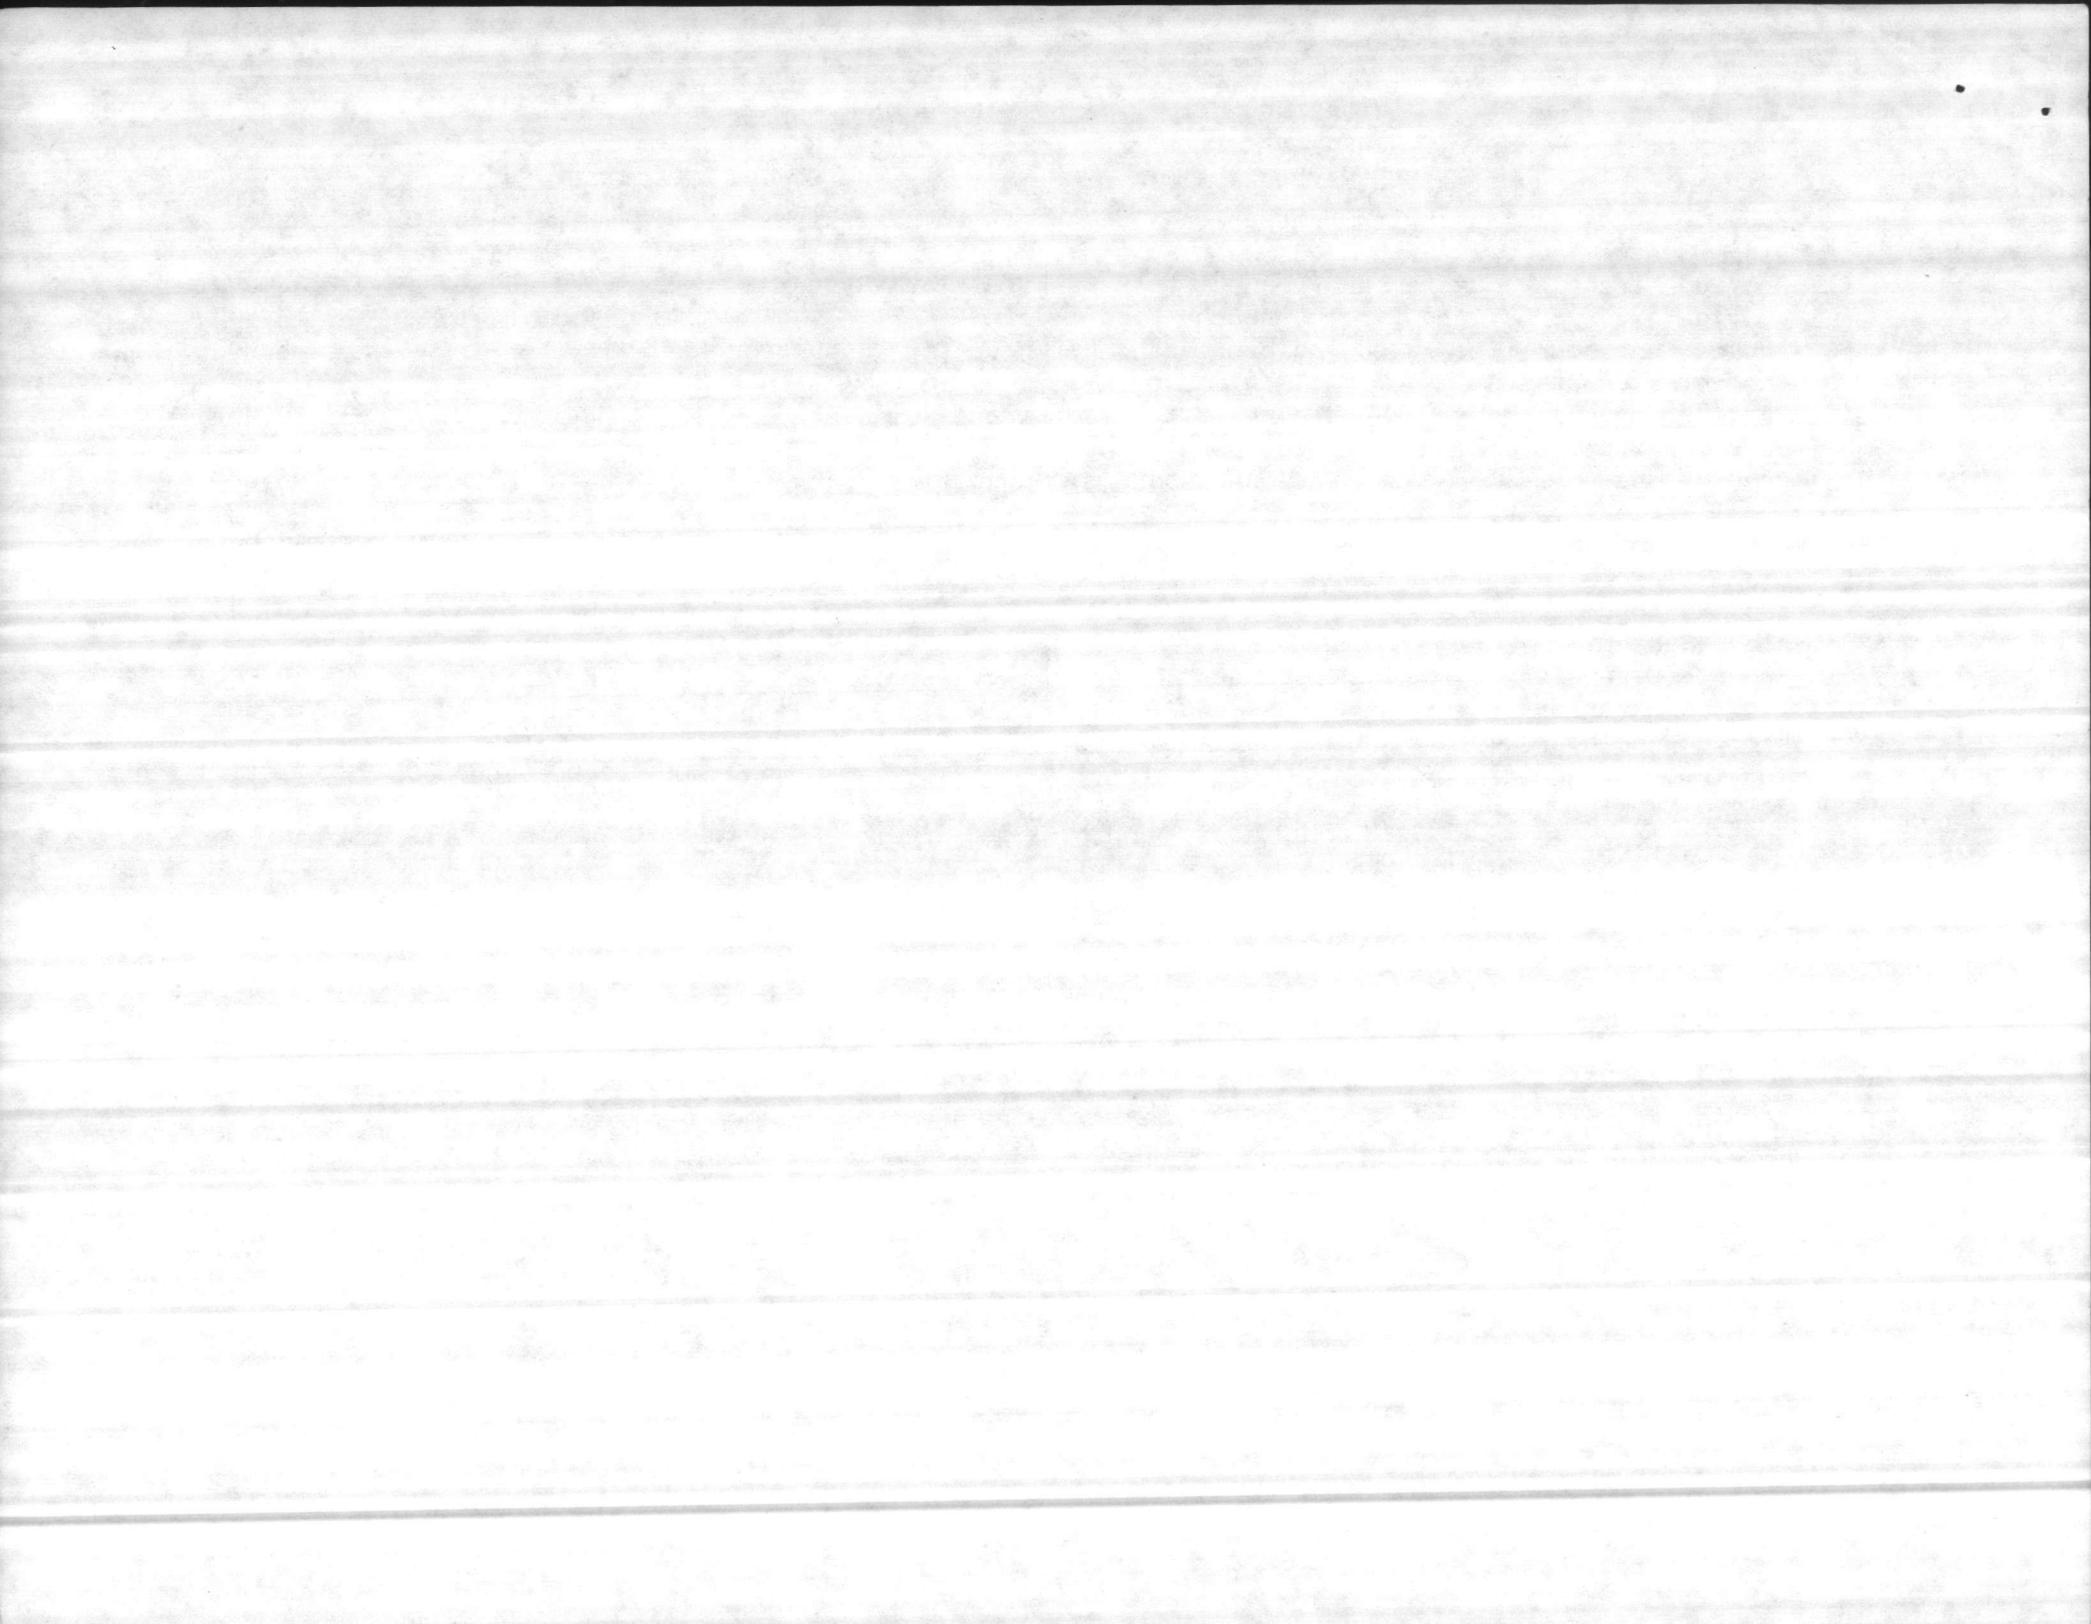


INDUSTRIAL AREA

Bldg. No.	Recommendation	Project	Est. Cost
900	Provide standard exterior stairway from the second floor	MilCon Proj.	\$ 12,000.
		being developed	
902	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	120,000.
903	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	150,000.
904	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	120,000.
905	(1) Provide Automatic Sprinkler Protection throughout	R-2 FY-87	140,000.
	(2) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	8,000.
	(3) Provide standard exterior stairway from the second floor	Mil Con Project	being 12,000.
		developed	
906	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	120,000.
907	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	120,000.
909	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	80,000.
914	(1) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	8,000.
	(2) Provide standard exterior stairway from the second floor	Mil Con Project	being 12,000.
		developed	
	(3) Extend present Sprinkler System Protection for 100% coverage	Mil Con Project	being Not Available
		developed	
1004	Upgrade the fuel transfer and storage to comply in all respects with NFPA-30	Corrected	Not Available
1005	Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	8,000.
1006	Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	6,000.
1011	(1) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	8,000.
	(2) Provide standard exterior stairway from the second floor	Mil Con Project	being 12,000.
		developed	
	(3) Extend present Sprinkler System Protection for 100% coverage	Mil Con Project	being Not Available
		developed	
1101	(1) Provide 2 hour fire rated wall to separate the electronic data processing section from adjoining warehouse occupancies	R-2 FY-87	Not Available
	(2) Extend present Fire Alarm System for 100% coverage	R-2 FY-87	6,000.
	(3) Extend present Sprinkler System to east end for 100% coverage	R-1 FY-87	40,000.
1108	(1) Provide Automatic Sprinkler Protection throughout	R-2 FY-87	120,000.
	(2) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	6,000.
1116	(1) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	8,000.
	(2) Provide standard exterior stairway from the second floor	Mil Con Project	being 12,000.
		developed	
	(3) Extend present Sprinkler System Protection for 100% coverage	Mil Con Project	being Not Available
		developed	
	(4) Provide automatic self closing UL listed class A Fire doors on both sides of all wall openings	Minor Con Project	Not Availabe
		being developed	

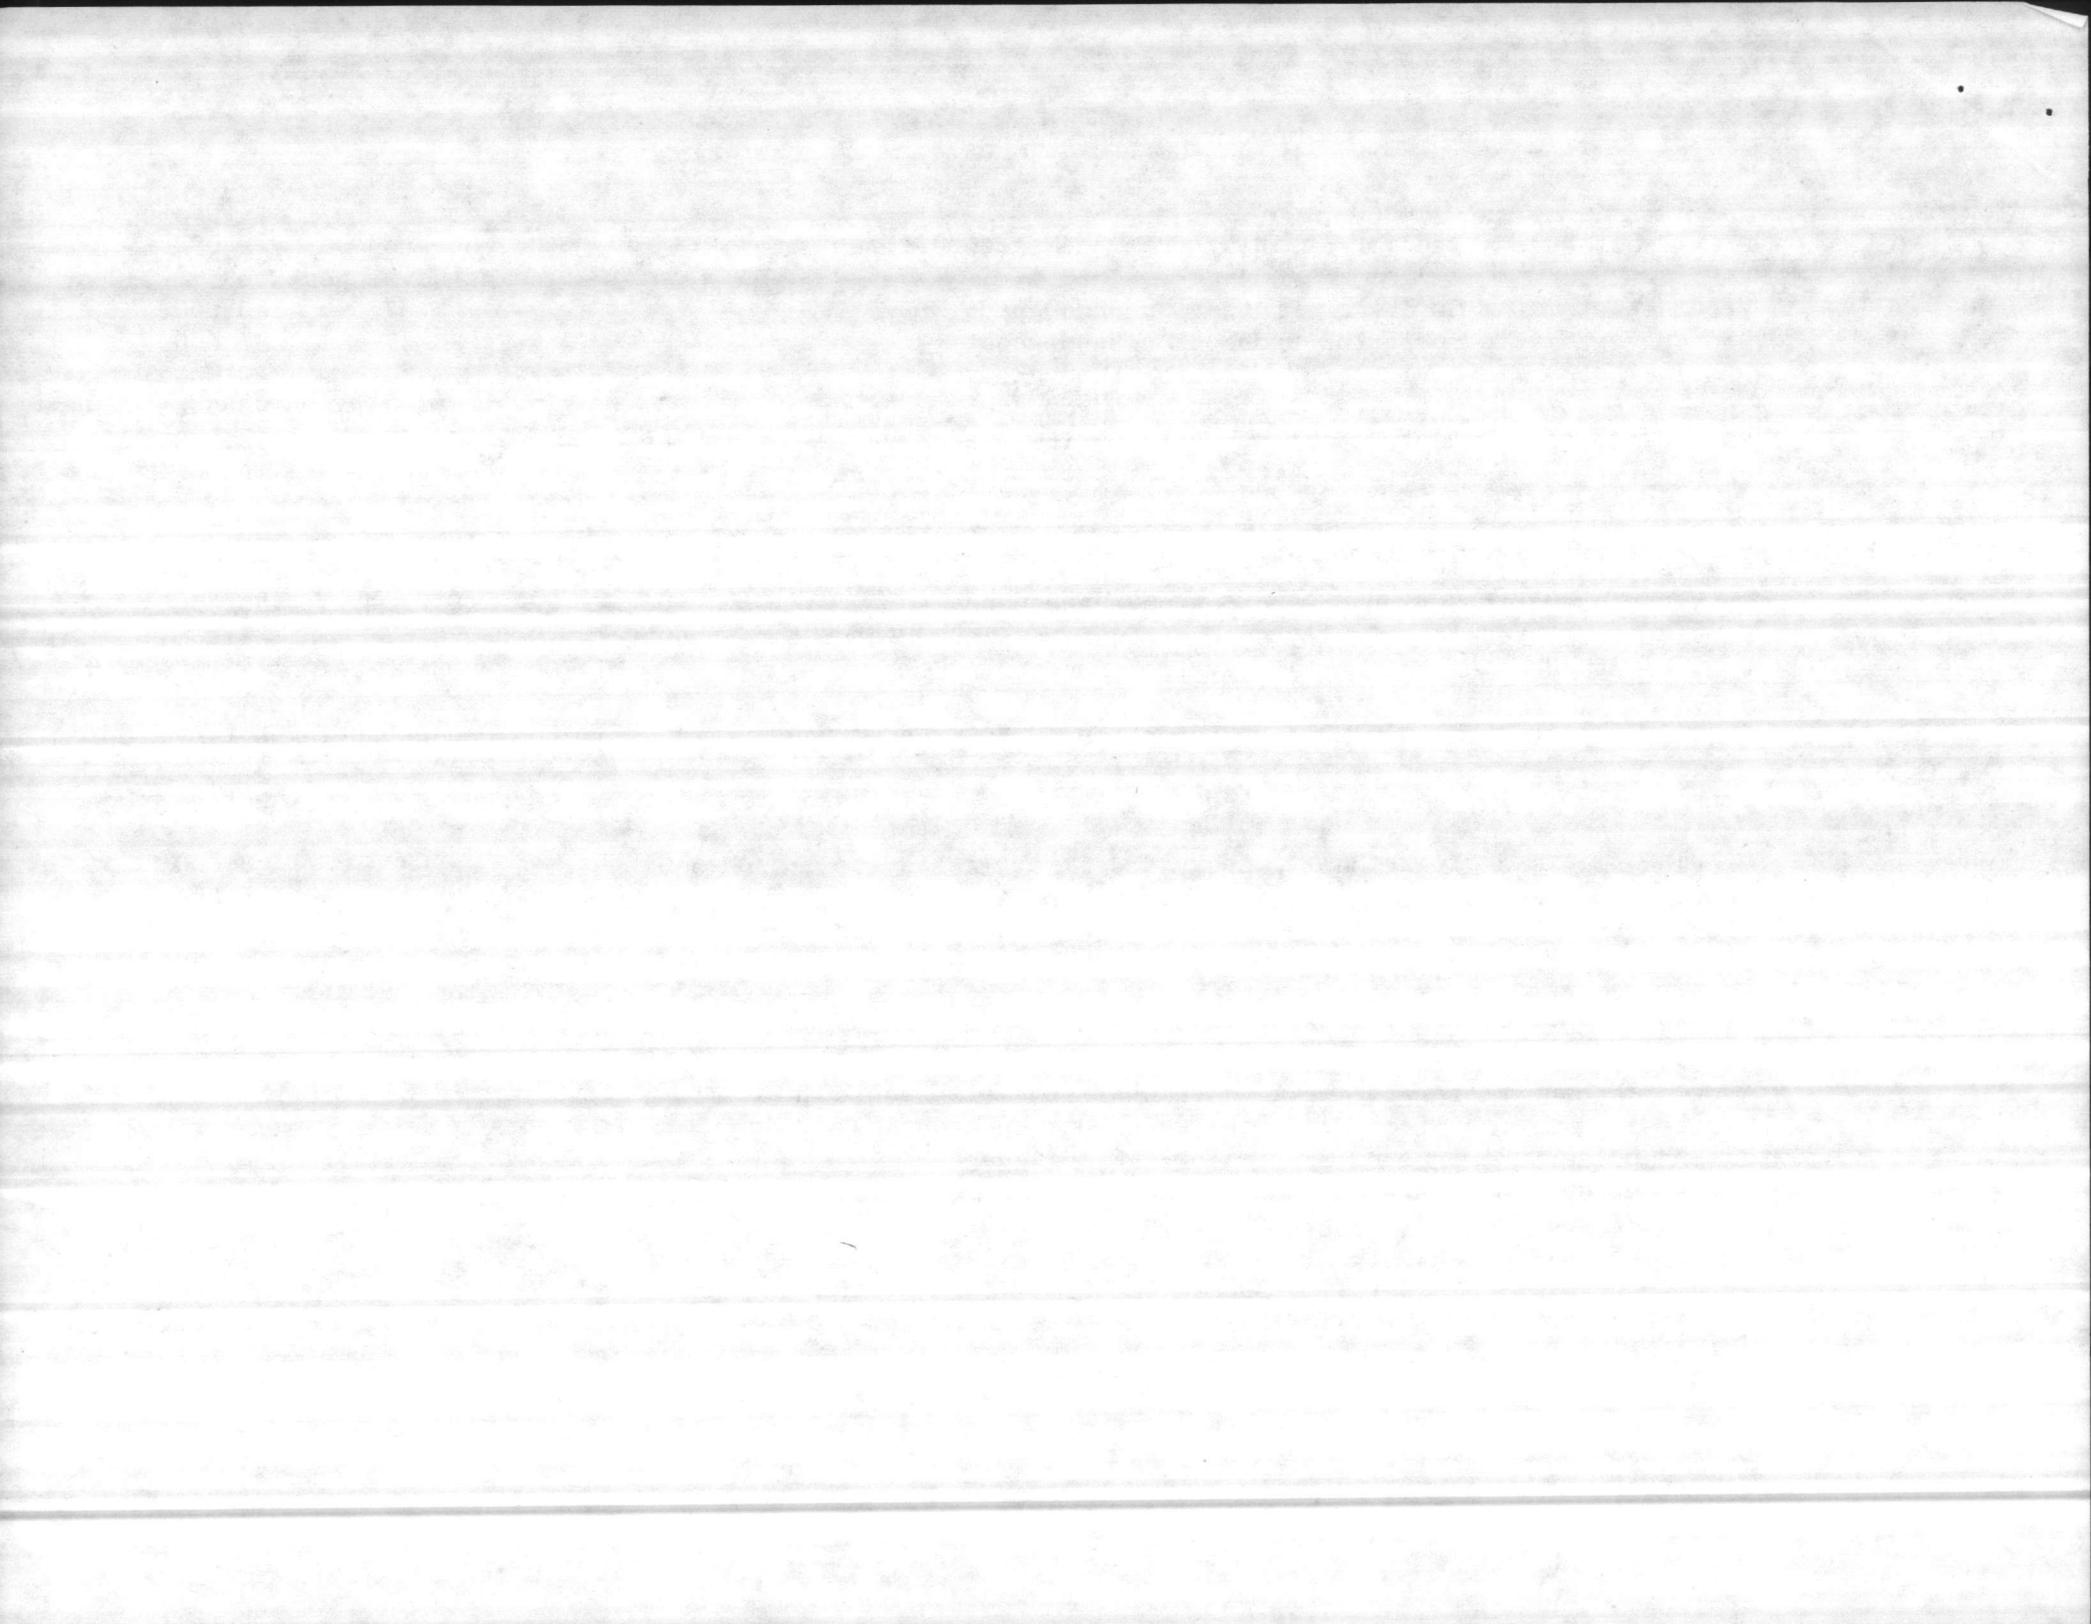


INDUSTRIAL AREA Continued

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
1118	(1) Extend present Sprinkler System Protection for 100% coverage	Mil Con Project being developed	Not available
	(2) Provide automatic self closing UL liste Class A fire doors on both sides of all wall openings	Minor Con Project being developed	Not available
1200	(1) Provide Automatic Sprinkler Protection throughout	R-2 FY-87	80,000.
	(2) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	6,000.
1201	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	130,000.
1202	(1) Provide Automatic Sprinkler Protection throughout	R-2 FY-87	80,000.
	(2) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	10,000.
	(3) Provide standard exterior stairway from the second floor	Mil Con Project being developed	12,000.
1211	(1) Extend present Sprinkler System for 100% coverage	Mil Con Project being developed	Not available
	(2) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	12,000.
	(3) Provide standard exterior stairway from the second floor	Mil Con Project being developed	12,000.
	(4) Provide automatic self closing UL listed Class A fire doors on both sides of all wall openings	Minor Con Project being developed	Not available
1212	(1) Extend present Sprinkler System to cover south office section	Mil Con Project being developed	Not available
	(2) Provide automatic self closing UL listed Class A fire doors on both sides of all wall openings.	Minor Con Project being developed	Not available
1301	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	130,000.
1316	(1) Extend present Sprinkler System for 100% coverage	Mil Con Project being developed	Not available
	(2) Provide automatic self closing UL listed Class A fire doors on both sides of all wall openings	Minor Con Project being developed	Not available
1317	(1) Extend present Sprinkler System for 100% coverage	Mil Con Project being developed	Not available
	(2) Provide automatic self closing UL listed Class A fire doors on both sides of all wall openings	Minor Con Project being developed	Not available
1401	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	40,000.
1402	Extend present Sprinkler System for 100% coverage	Mil Con Project being developed	Not available
1500	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	75,000.
1501	Provide Automatic Sprinkler Protection throughout	R-2 FY-87	120,000.

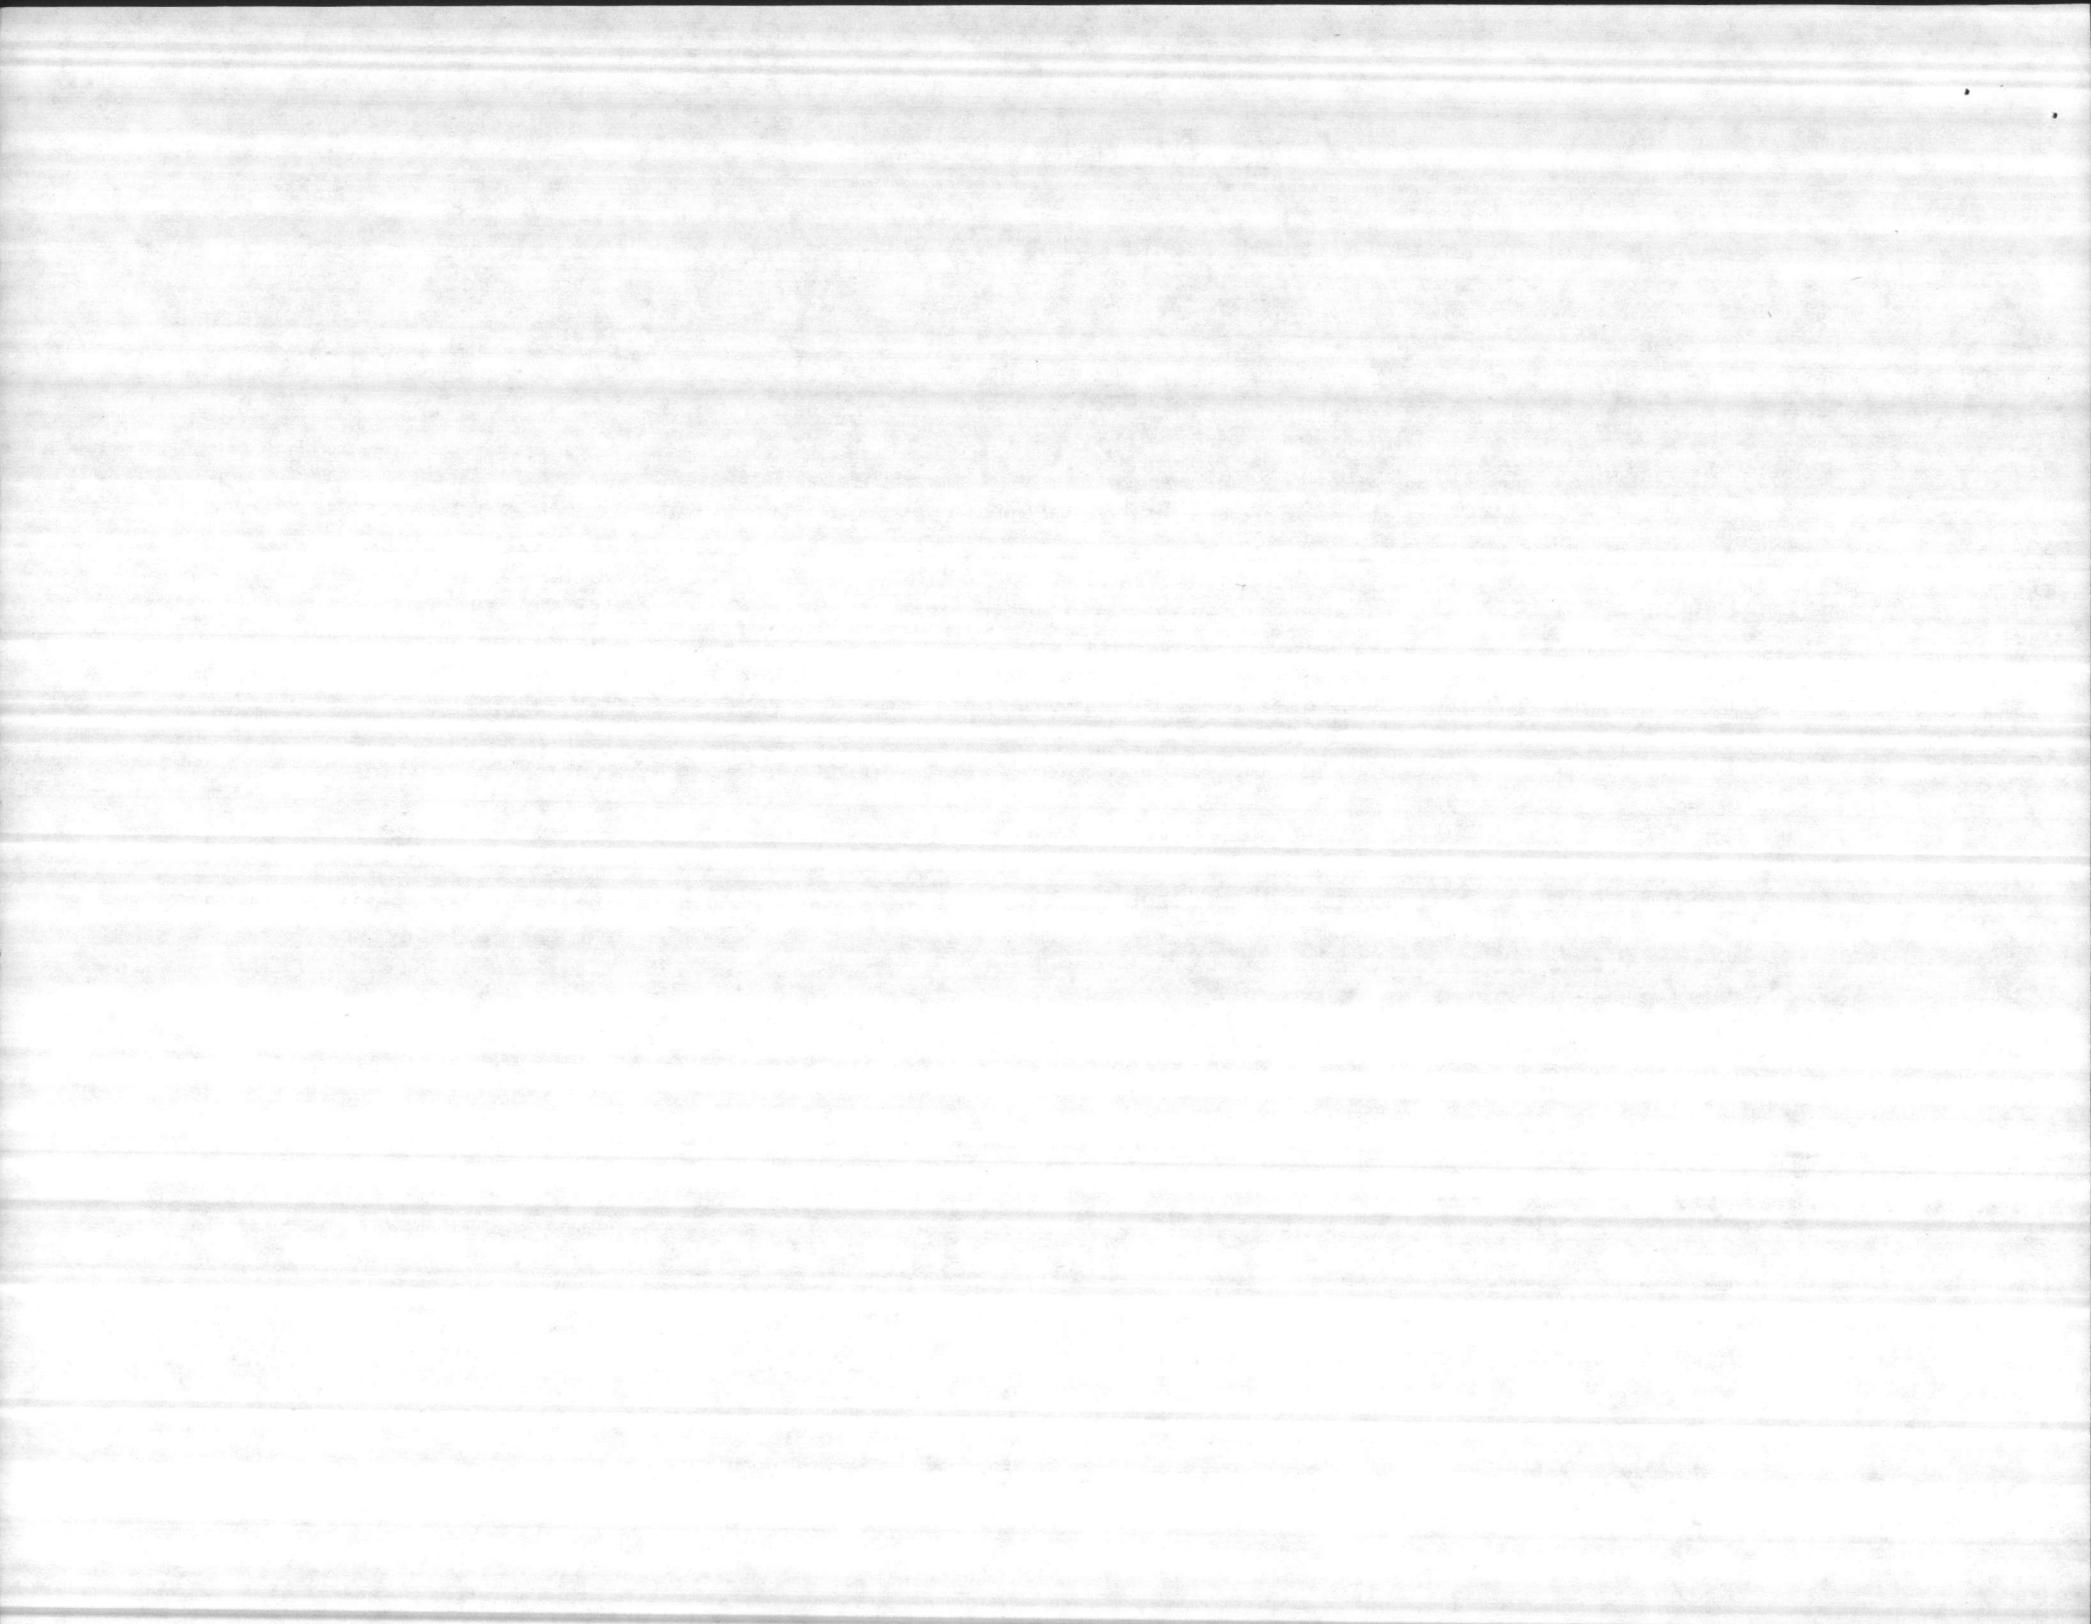

INDUSTRIAL AREA Continued

<u>Bldg. NO.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
1502	(1) Provide Automatic Sprinkler Protection throughout	R-2 FY-87	140,000.
	(2) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	5,000.
	(3) Provide standard exterior stairway from the second floor	Mil Con Project being developed	12,000.
1601	(1) Provide Automatic Sprinkler Protection throughout	R-2 FY-87	140,000.
	(2) Provide complete electrically supervised Fire Alarm System throughout	R-2 FY-87	8,000.
	(3) Provide standard exterior stairway from the second floor	Mil Con Project being developed	12,000.
1606	Provide Automatic Sprinkler System Protection throughout	R-2 FY-87	120,000.

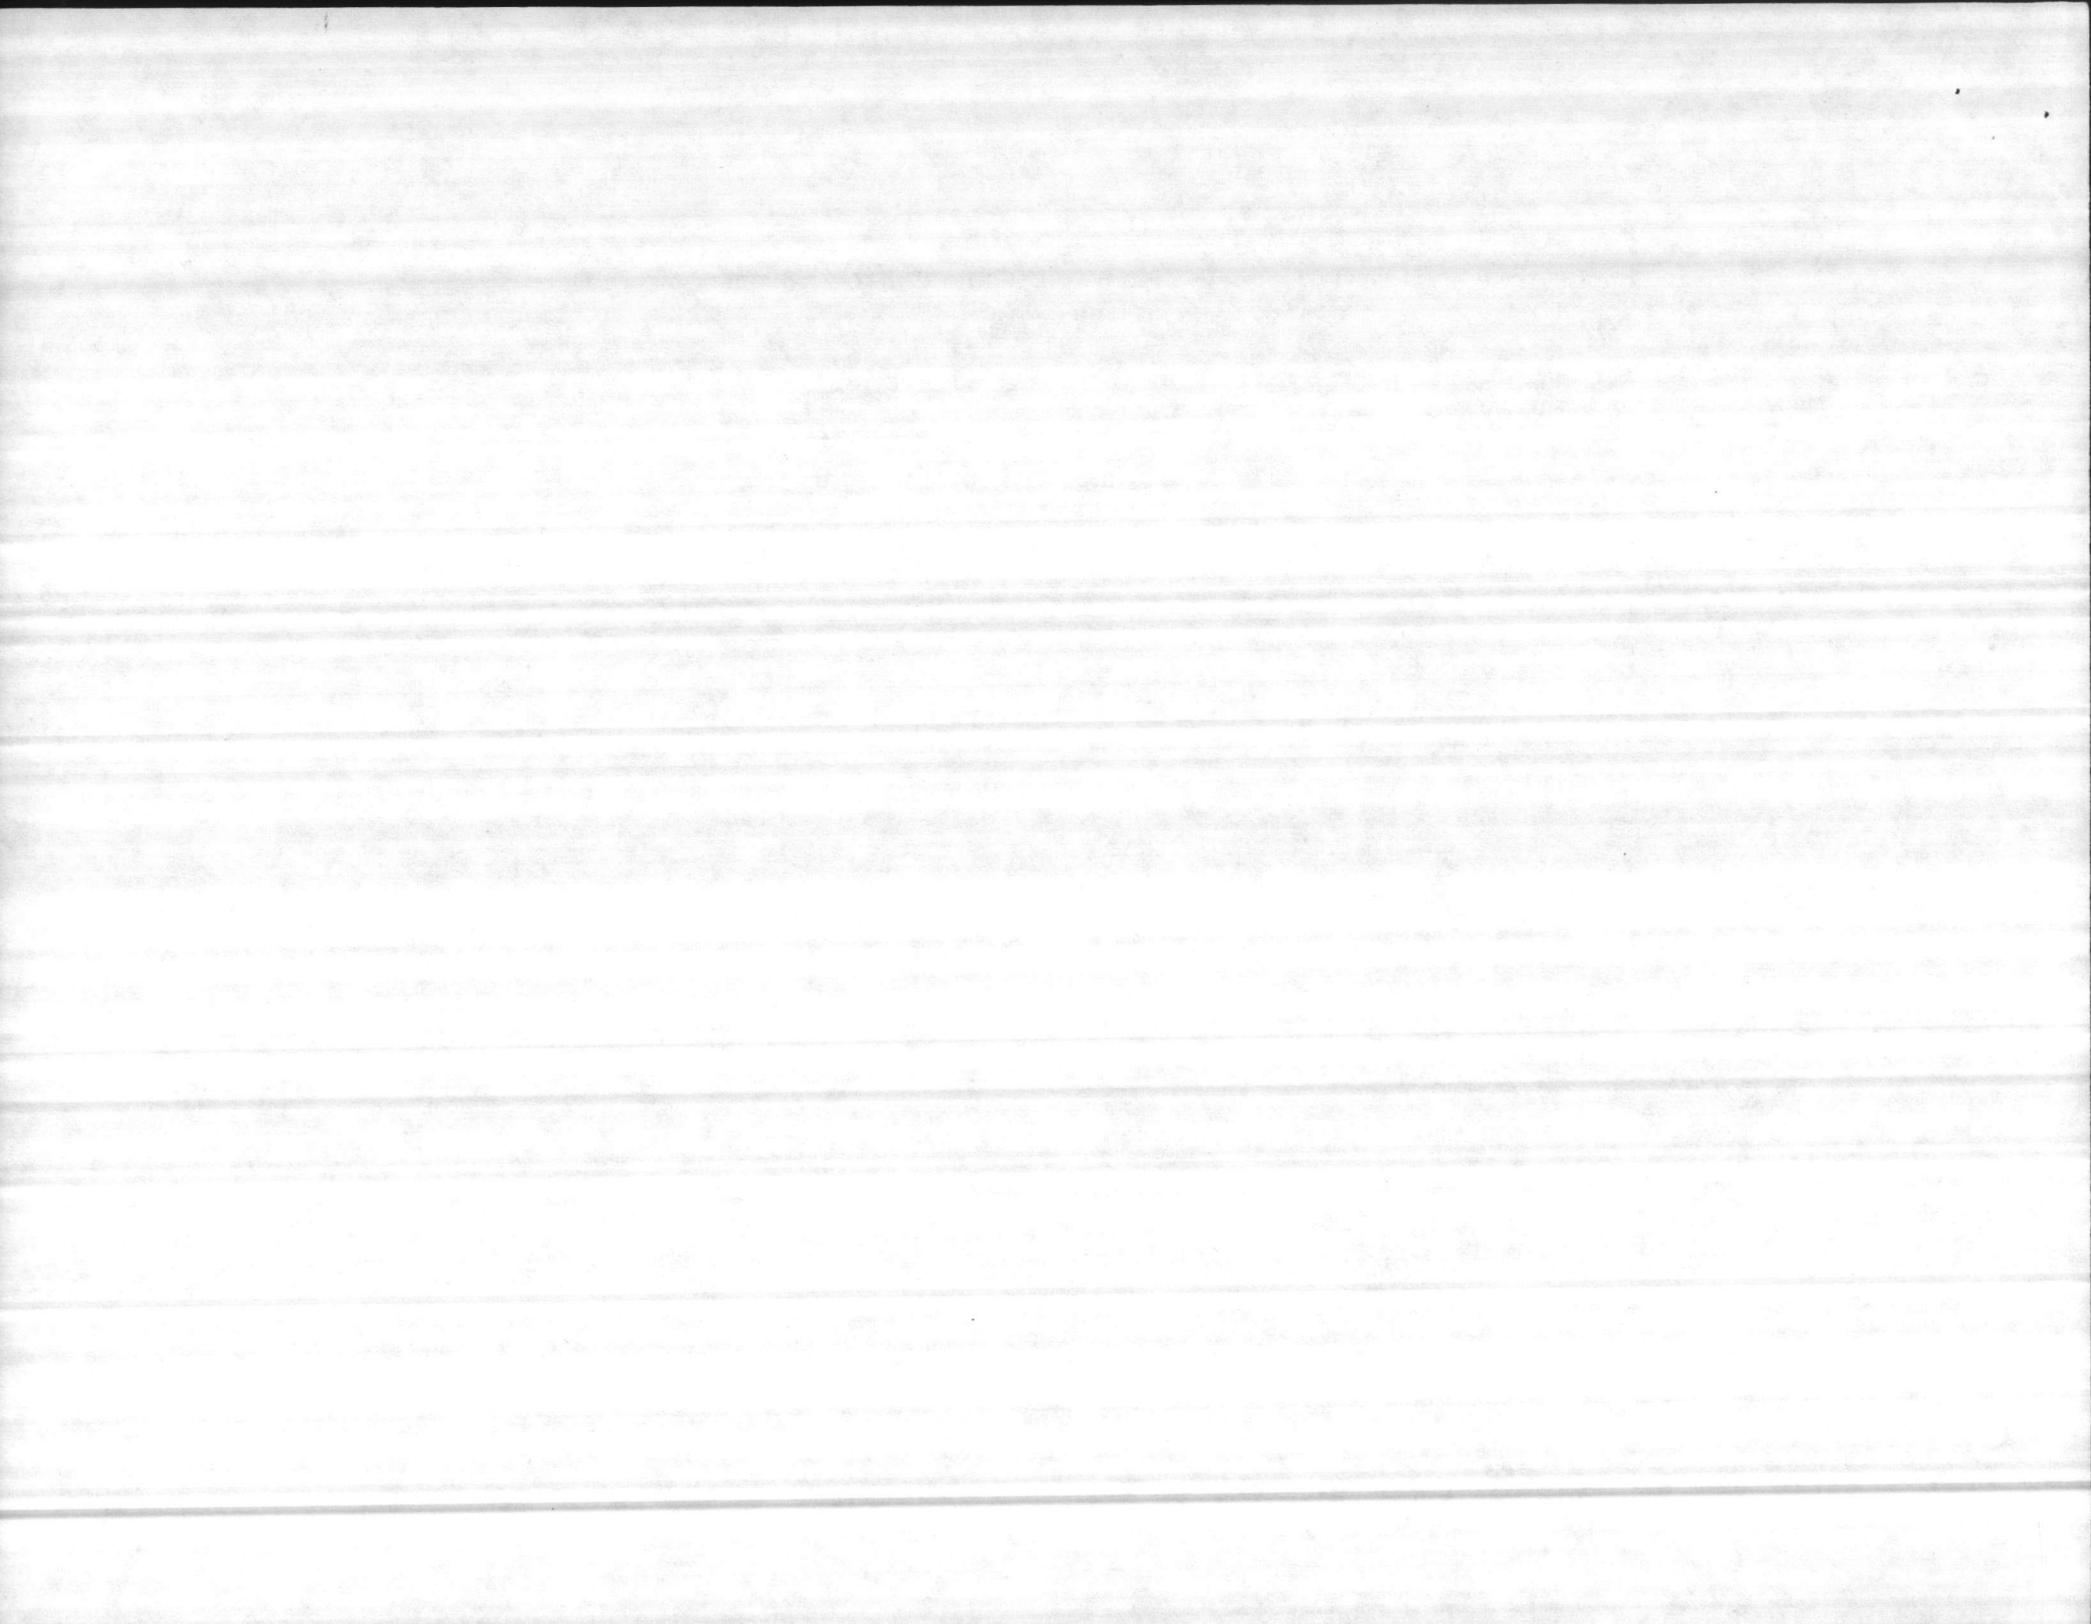

PARADISE POINT

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
1915	(1) Install automatic dry chemical fire extinguisher system for the protection of all type cooking systems and surface units	Programed for FY-86 and/or FY-87	Not available
	(2) Provide automatic sprinkler system throughout	R-2 FY-87	4,000.
2061	(1) Provide complete fire alarm system throughout, install hard-wire smoke single station detectors in sleeping rooms, central corridor and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire door	R-2 FY-87	8,000.
2602	(1) Provide complete fire alarm system throughout, install hard-wire single station smoke detectors in sleeping rooms central corridors, and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 Fy-87	8,000.
2603	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping room, central corridors, and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 FY-87	8,000.
	(3) Install battery powered emergency lights	R-2 FY-87	Not available
2604	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors,	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 FY 87	8,000.
2605	(1) Provide complete fire alarm system throughout, install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 FY-87	8,000.
2607	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 FY-87	8,000.
2609	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping room, central corridors, and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 FY-87	8,000.




PARADISE POINT Continued

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
2611	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping room, central corridors, and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 FY-87	8,000.
2613	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping room central corridors, and lounges	R-2 FY-87	8,000.
	(2) Enclose interior stairwell with one hour construction and self-closing Class B fire doors	R-2 FY-87	8,000.
2615	Provide automatic sprinkler system throughout.	R-2 Prepared Proj. #LE-631-R	170,000.




CAMP JOHNSON

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
M-19	(1) Provide a dry chemical extinguishing system for the cooking hood and cooking surfaces		
M-128	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges.	Scheduled for redesignation	15,000.
	(2) Install battery powered emergency lights	"	Not available
M-130	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping room, central corridors, and lounges	Scheduled for redesignation	15,000.
	(2) Install battery powered emergency lights	"	Not available
M-132	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	Scheduled for redesignation	8,000.
M-231	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	LE-630-R	20,000.
	(2) Provide complete spinkler protection throughout.	LE-630-R	70,000.
	(3) Provide on hour fire rated enclosures for three interior stairways with Class B fire rated doors	LE-630-R	9,000.
	(4) Install battery powered emergency lights	LE-630-R	
M240	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	Club System to work up Proj.	8,000.
	(2) Provide complete sprinkler protection throughout	Club System to work up Proj.	35,000.

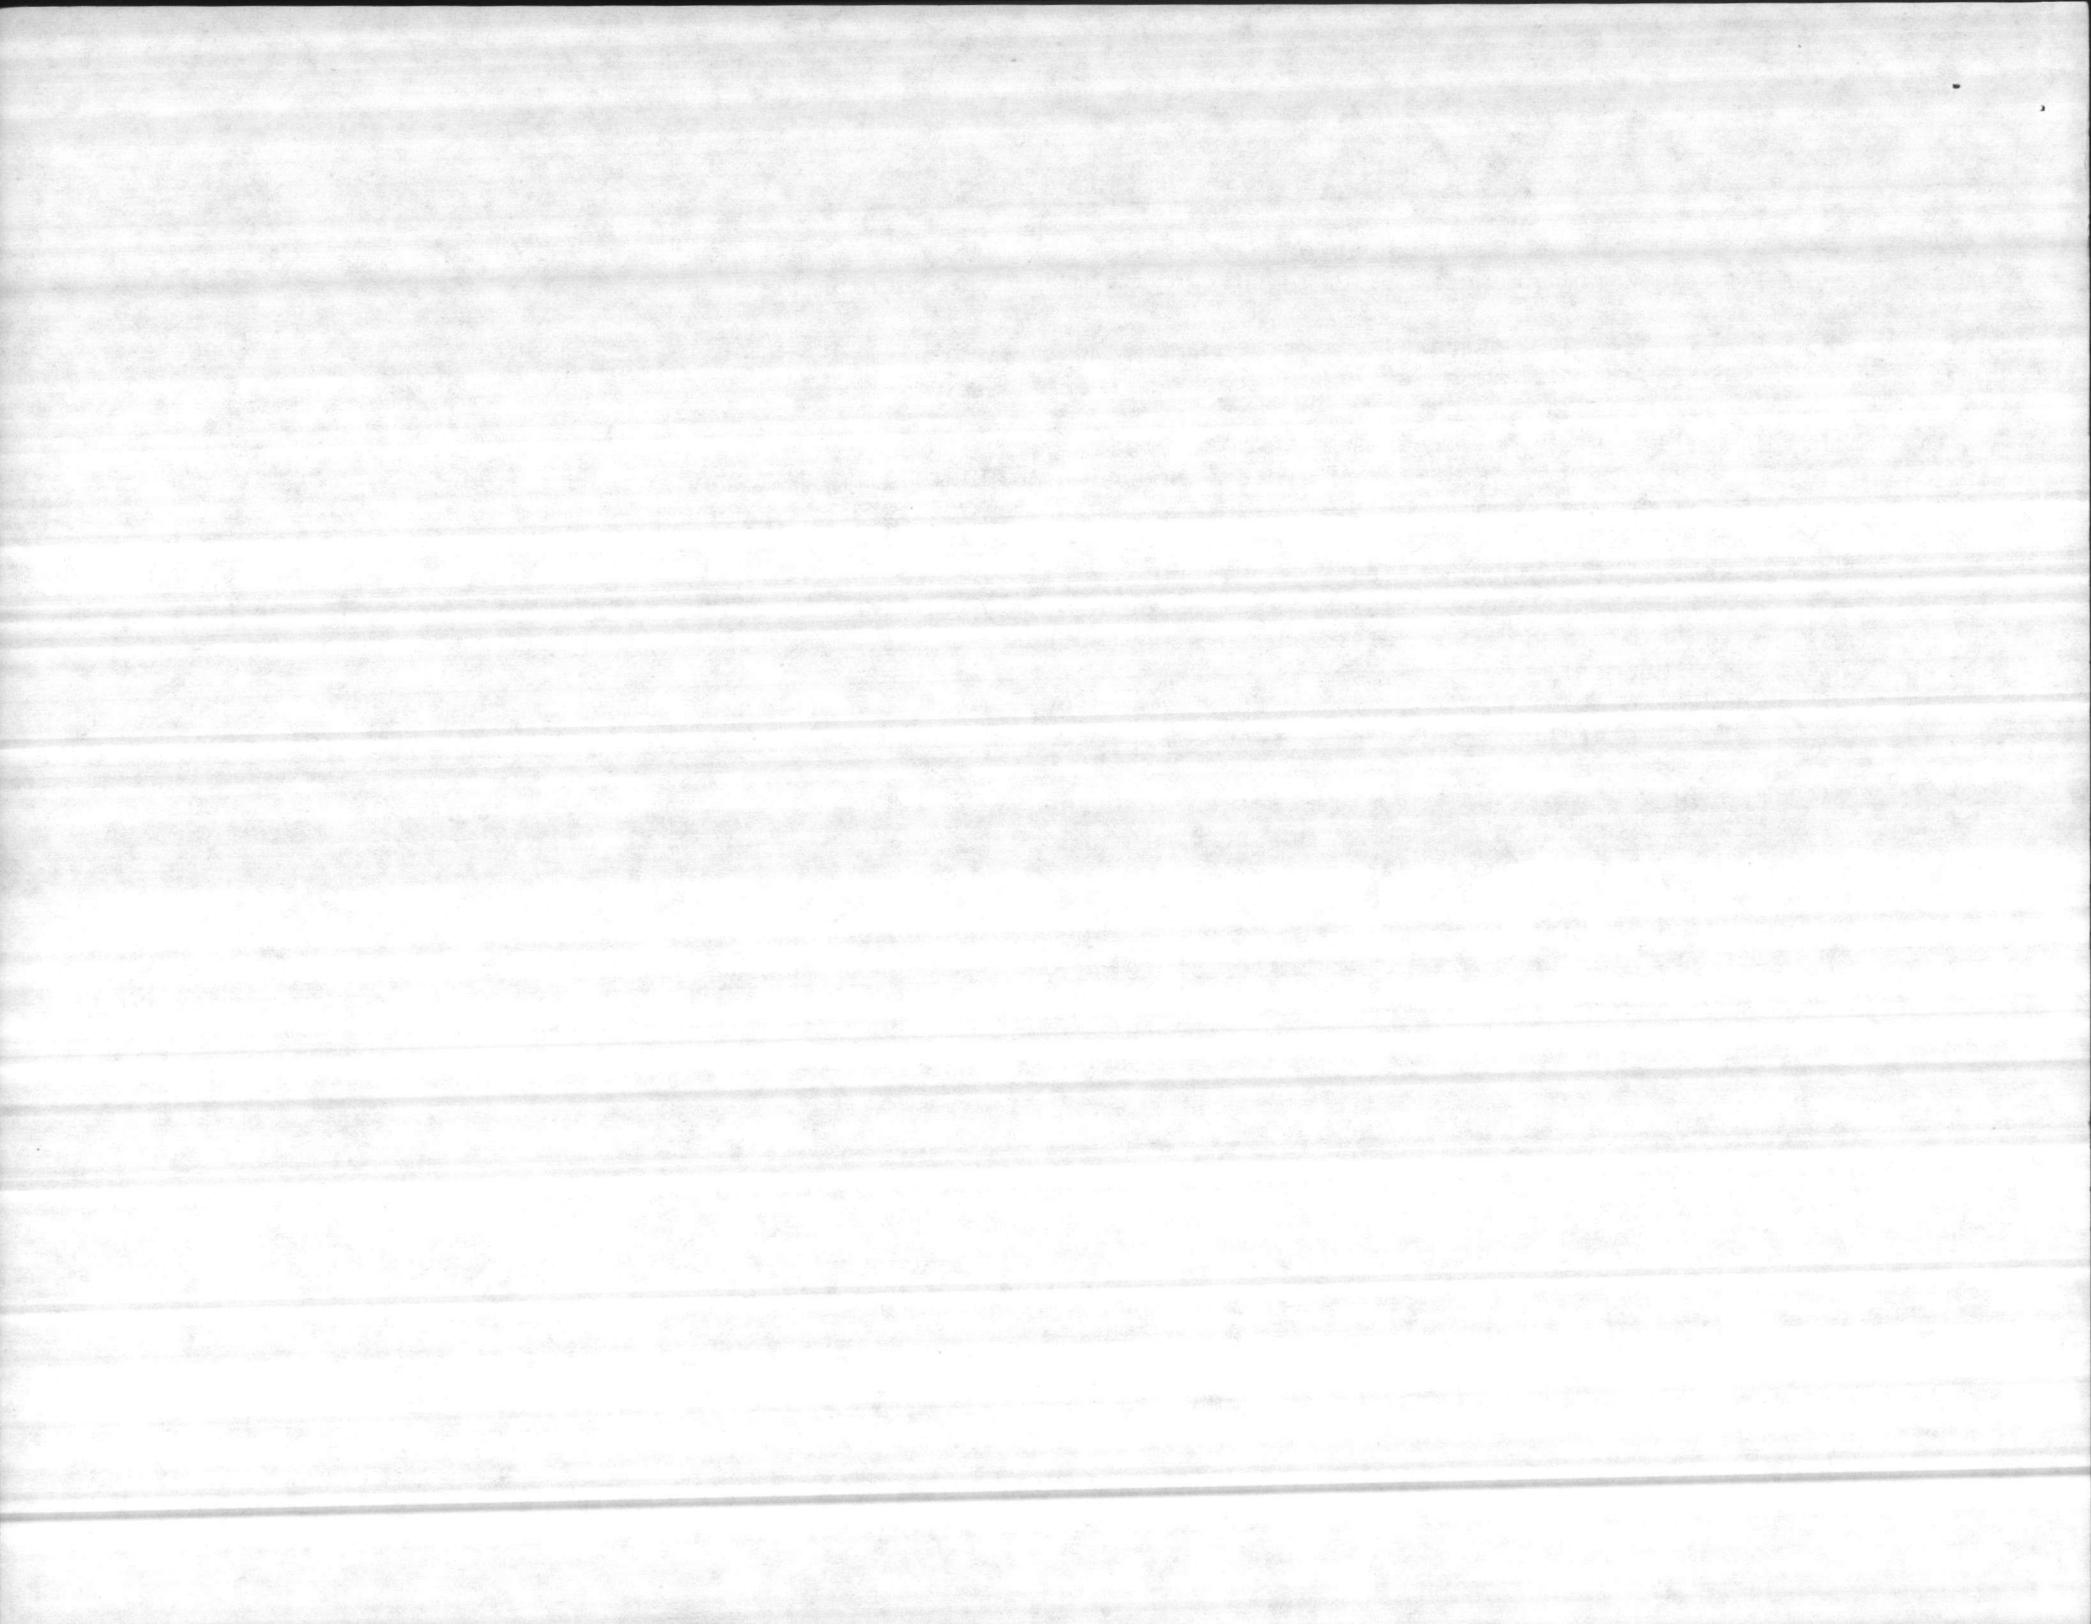


FRENCH CREEK

<u>Bldg. No.</u>	<u>Recommendations</u>	<u>Project</u>	<u>Est. Cost</u>
FC-303	(1) Install automatic dry chemical extinguishing system for all cooking systems and cooking surfaces	Programmed for FY-86	Not available
FC-304	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms central corridors, and lounges	R-2 FY-87	10,000.
	(2) Install battery powered emergency lights	R-2 FY-87	Not available
FC-305	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping room, central corridors, and lounges	R-2 FY-87	10,000.
	(2) Install battery powered emergency lights	R-2 FY-87	Not available
FC-306	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	R-2 FY-87	10,000.
	(2) Install battery powered emergency lights	R-2 FY-87	Not available.
FC-309	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	R-2 FY-87	10,000.
	(2) Install battery powered emergency lights	R-2 FY-87	Not available
FC-310	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	R-2 FY-87	10,000.
	(2) Install battery powered emergency lights	R-2 FY-87	Not available
FC-311	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping rooms, central corridors, and lounges	R-2 FY-87	10,000.
	(2) Install battery powered emergency lights	R-2 FY-87	Not available

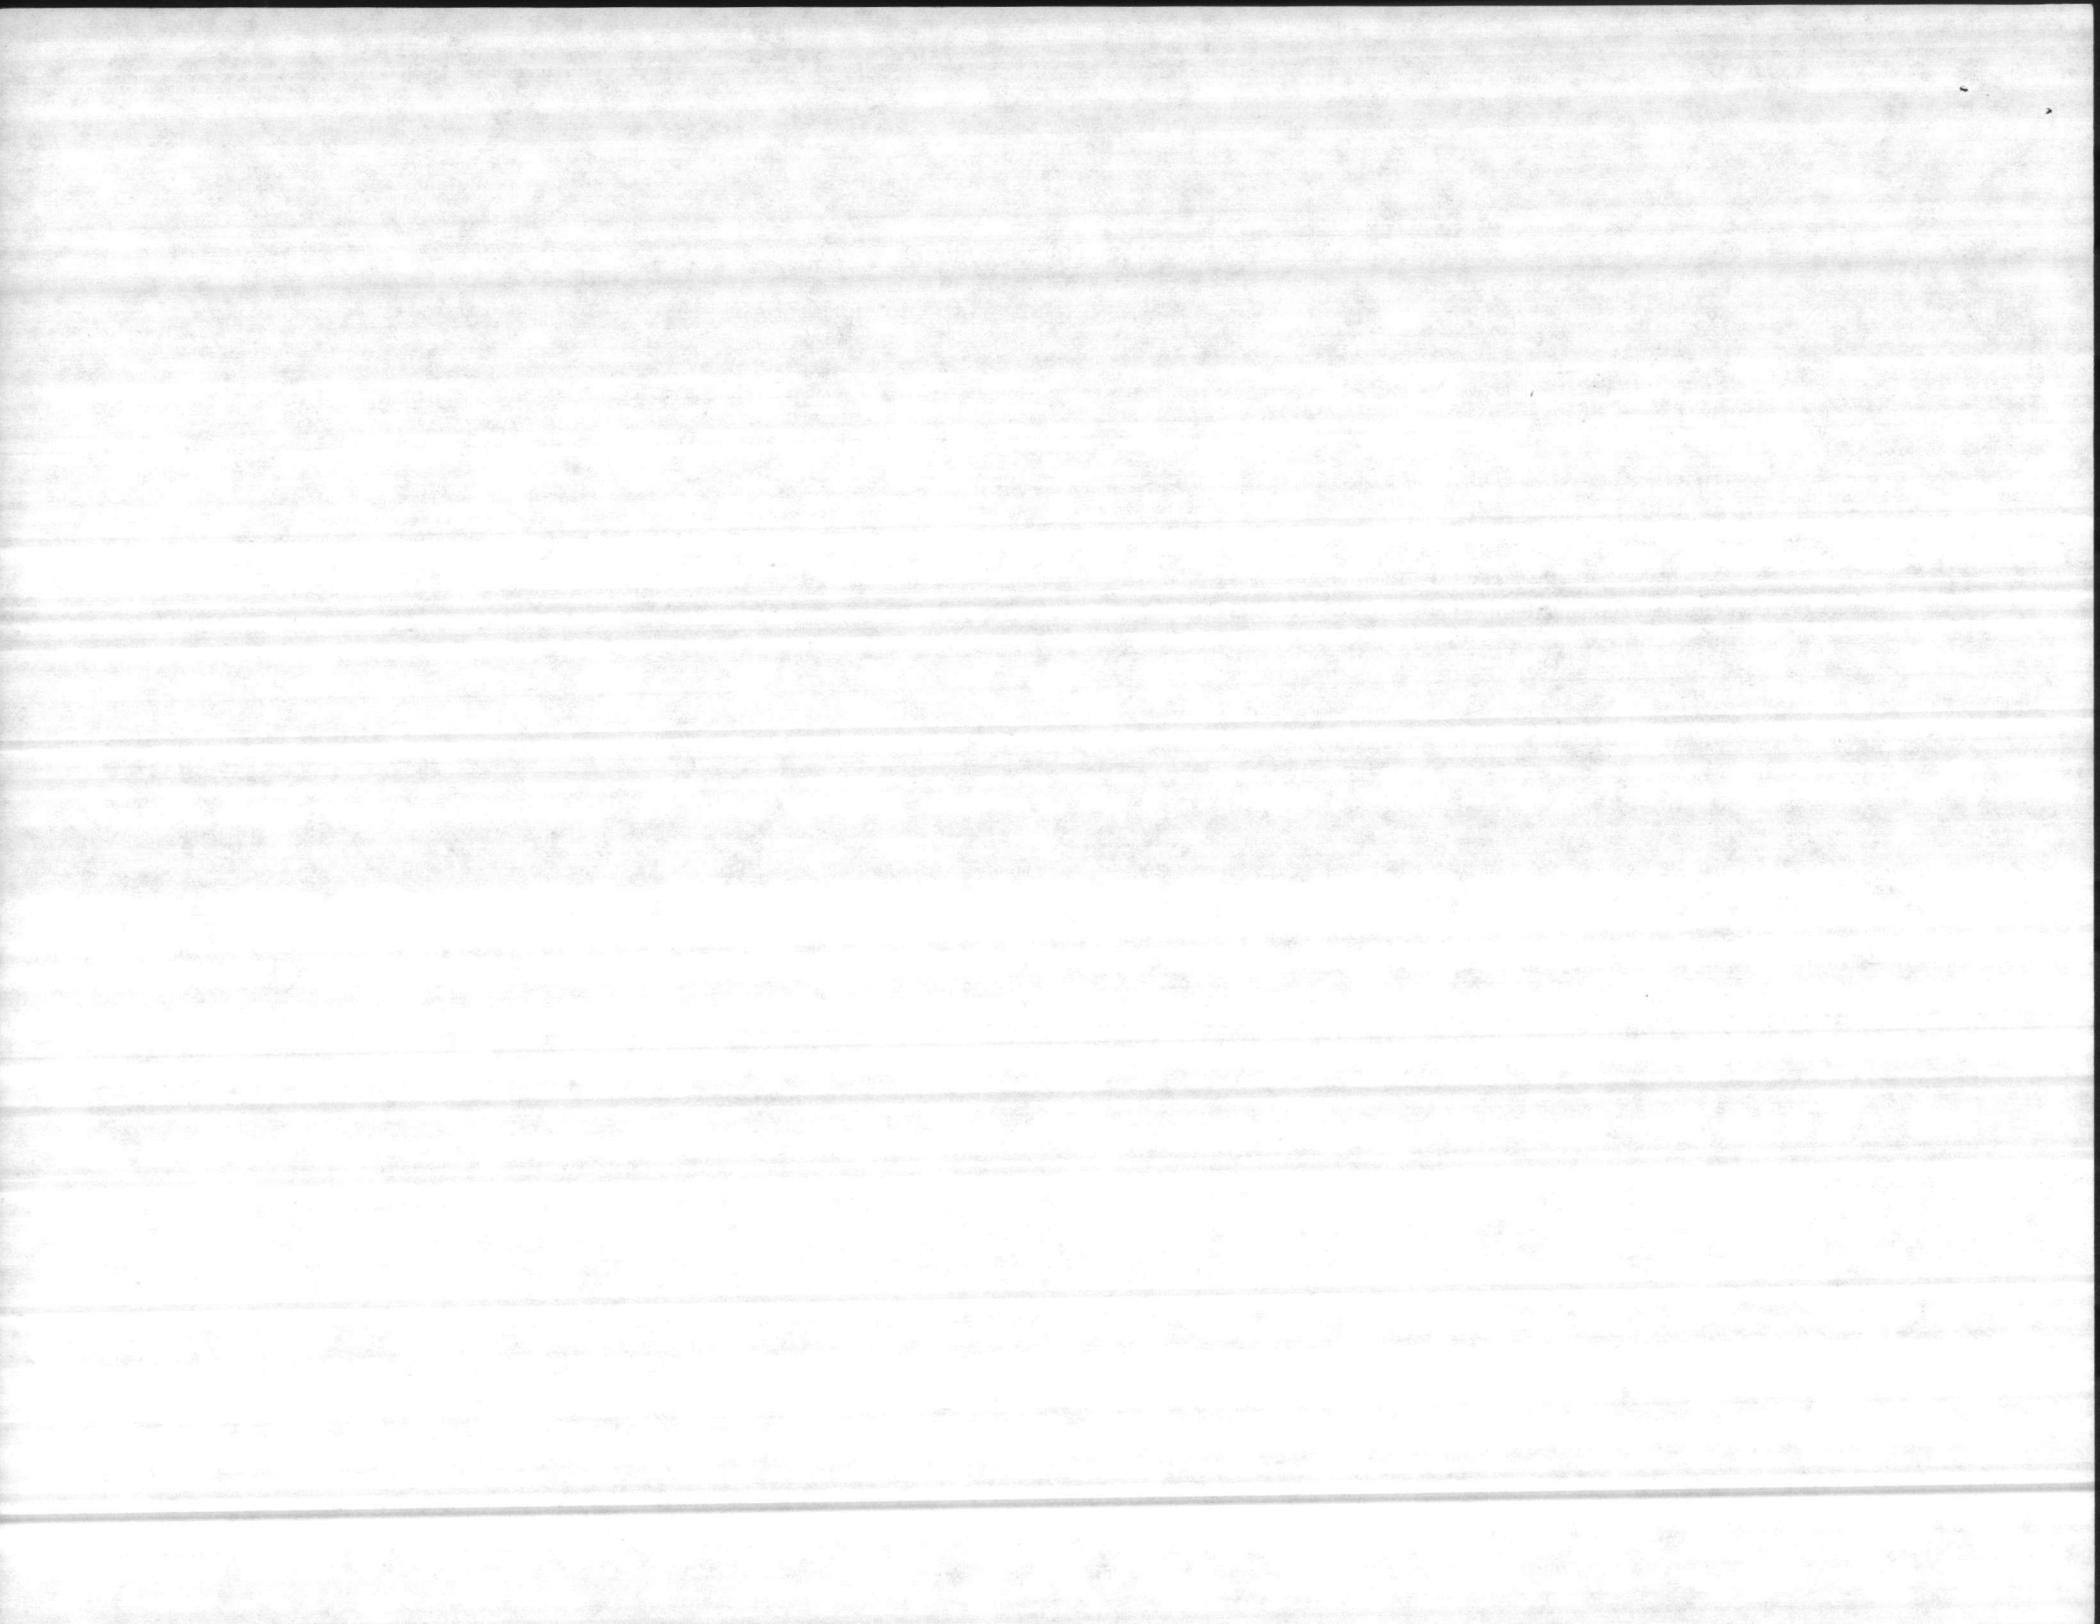

RIFLE RANGE

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
RR-1	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping areas, central corridors, and lounges	R-2 FY-87	6,000.
	(2) Enclose interior stairwells with one hour fire rated construction and self-closing Class B fire doors	R-2 FY-87	12,000.
RR-2	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping areas, central corridors, and lounges	R-2 FY-87	6,000.
	(2) Enclose interior stairwells with one hour fire rated construction and self-closing Class B fire doors	R-2 FY-87	12,000.
RR-4	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping areas, central corridors, and lounges	R-2 FY-87	6,000.
	(2) Enclose interior stairwells with one hour fire rated construction and self-closing Class B fire doors	R-2 FY-87	12,000.
RR-5	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping areas, central corridors, and lounges	R-2 FY-87	6,000.
	(2) Enclose interior stairwells with one hour fire rated construction and self-closing Class B fire doors	R-2 FY-87	12,000.
RR-9	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping areas, central corridors, and lounges	R-2 FY-87	6,000.
	(2) Install battery powered emergency lights	R-2 FY-87	Not available
RR-11	(1) Provide complete fire alarm system throughout. Install hard-wire single station smoke detectors in sleeping areas, central corridors, and lounges	R-2 FY-87	6,000.
	(2) Enclose interior stairwells with one hour fire rated construction and self-closing Class B fire doors.	R-2 FY-87	12,000.

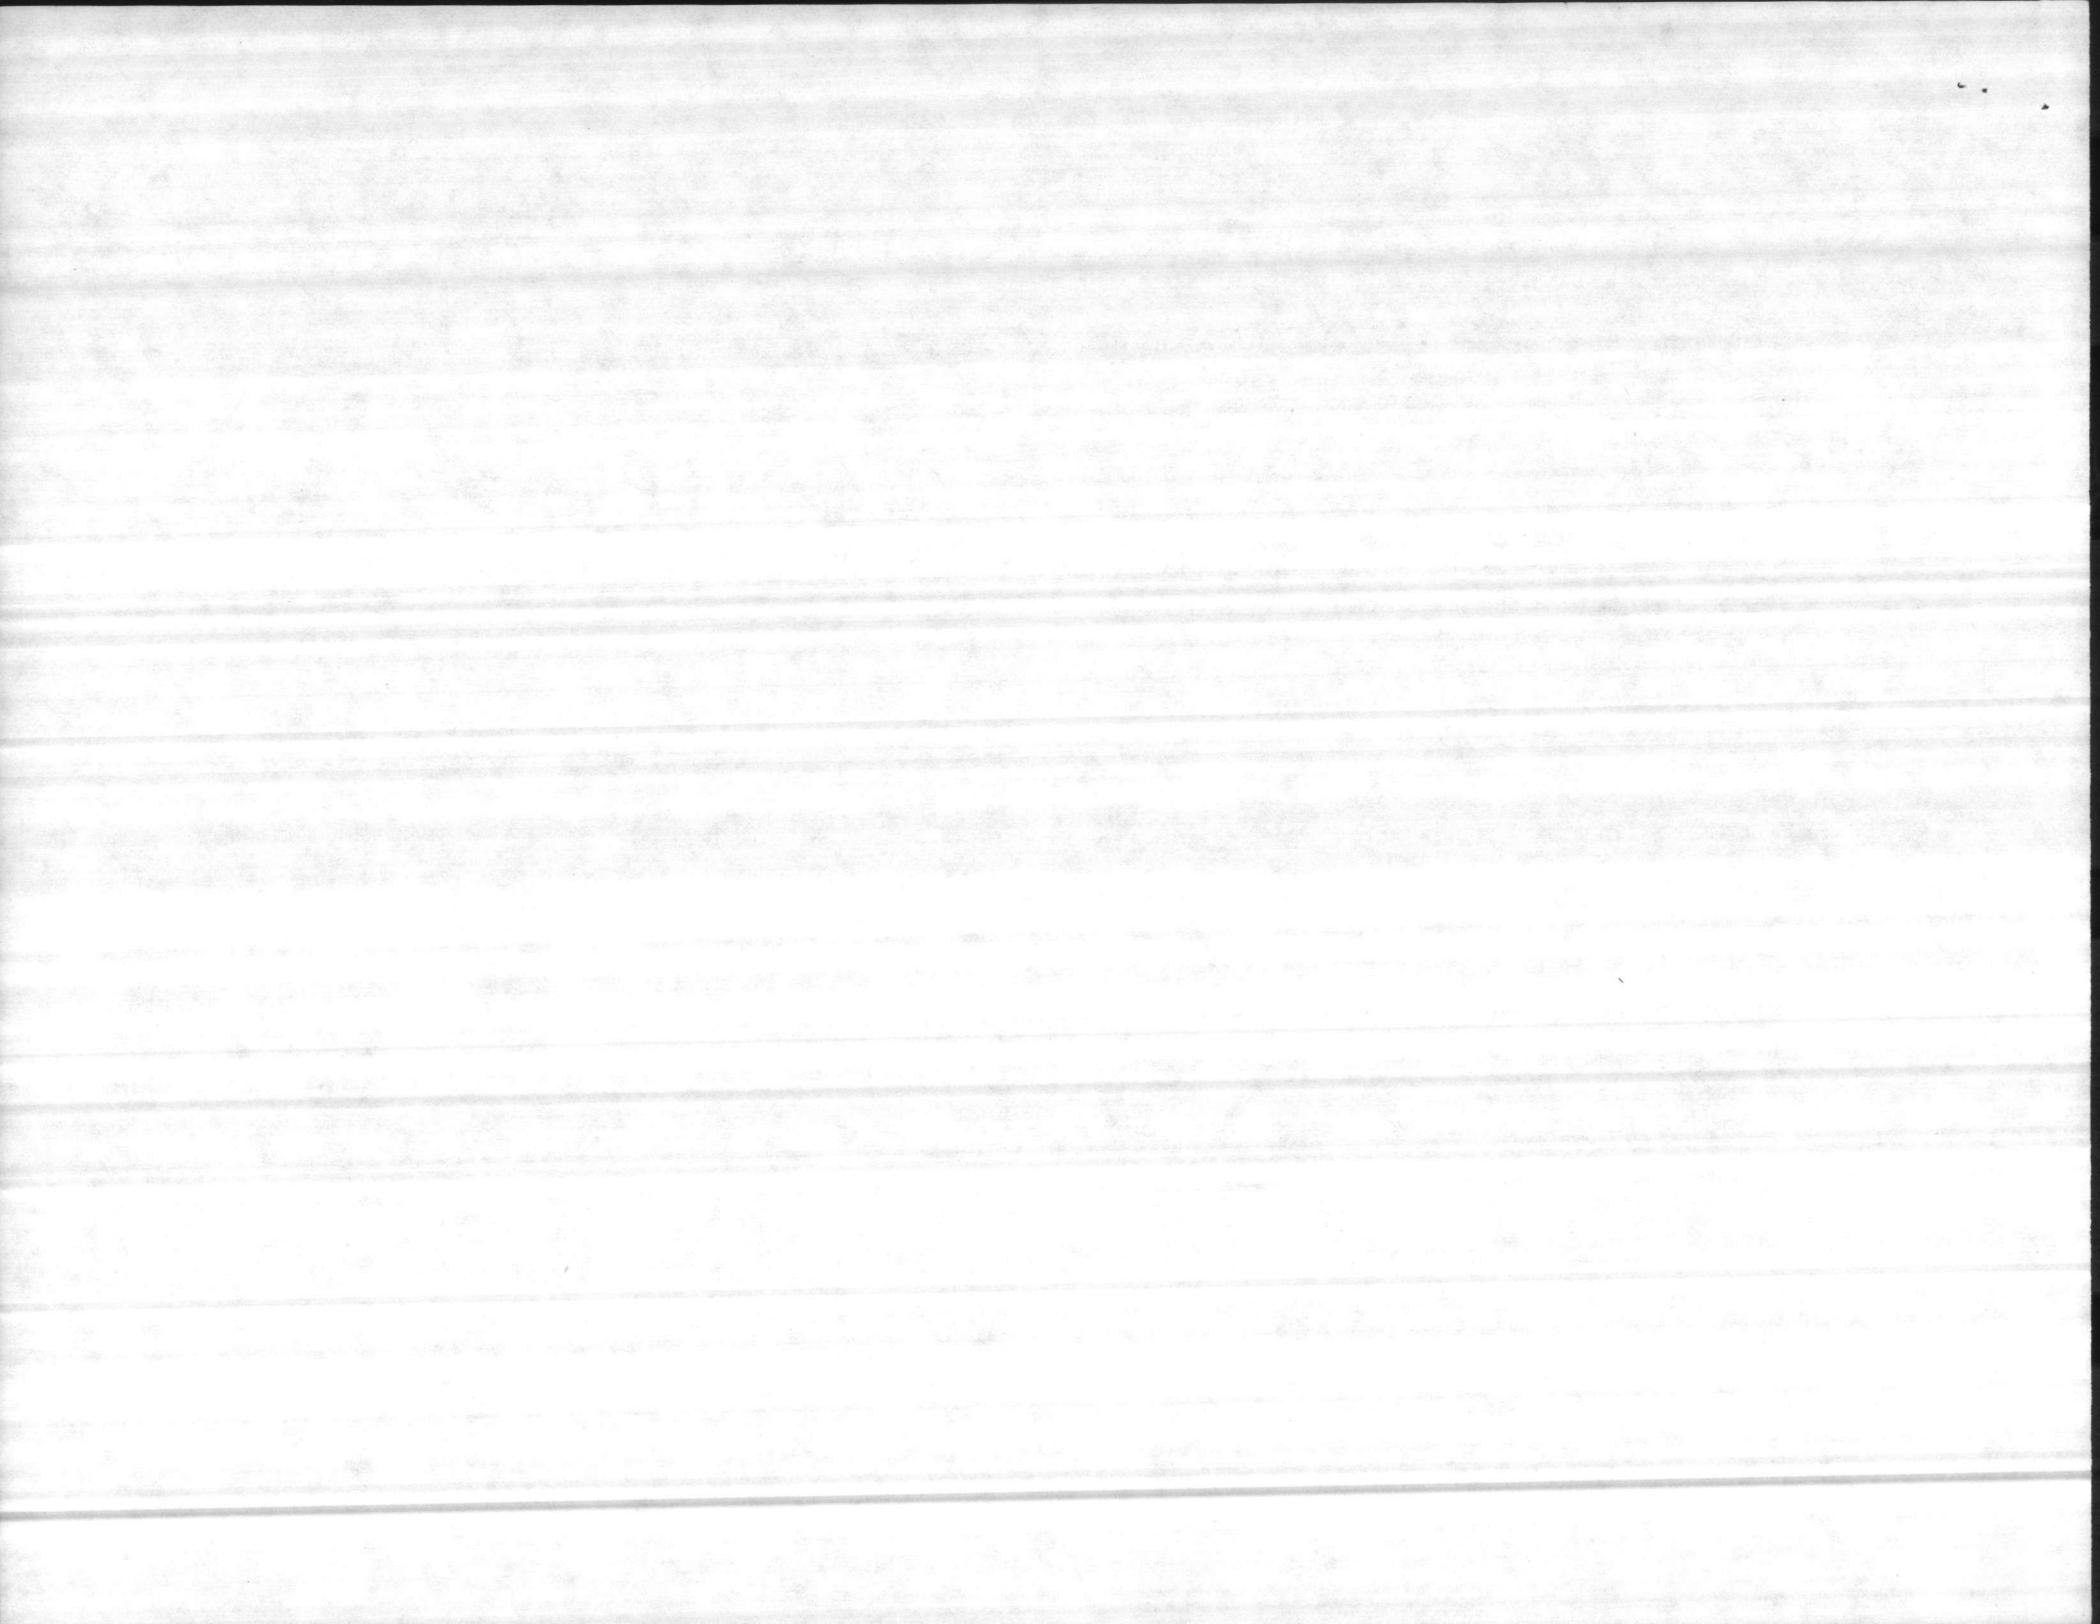

COURTHOUSE BAY

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
BB-45	(1) Enclose interior stairwell with one hour fire rated construction and self-closing Class B fire doors	R-2 FY-87	12,000.
	(2) Provide complete fire alarm system throughout	R-2 FY-87	8,500.
	(3) Provide automatic sprinkler protection throughout	R-2 FY-87	100,000.
	(4) Reactivate stairway exit 2nd floor east end	R-2 FY-87	Not available
	(5) Install battery powered emergency lighting	R-2 FY-87	Not available
BB-54	(1) Provide complete fire alarm system throughout	R-2 FY-87	3,000.
	(2) Provide automatic sprinkler system throughout	R-2 FY-87	40,000.



TARAWA TERRACE

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
TT-2455 - TT-2475	(1) Provide complete automatic spinkler system throughout	R-2 FY-87	180,000.

ONSLOW BEACH

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
BA-113	(1) Install dry chemical extinguishing system for all cooking systems and cooking surfaces	Programed for FY-86	Not available

MIDWAY PARK

<u>Bldg. No.</u>	<u>Recommendation</u>	<u>Project</u>	<u>Est. Cost</u>
LCH-4014	(1) Provide second exit from retail store	Scheduled for renovation FY-86	Not available

